


Test Report – Back Pressure

PMOS - 0532 茂德 DUPS 3 超載1,550 kW 溫度背壓曲線 06 April 2006

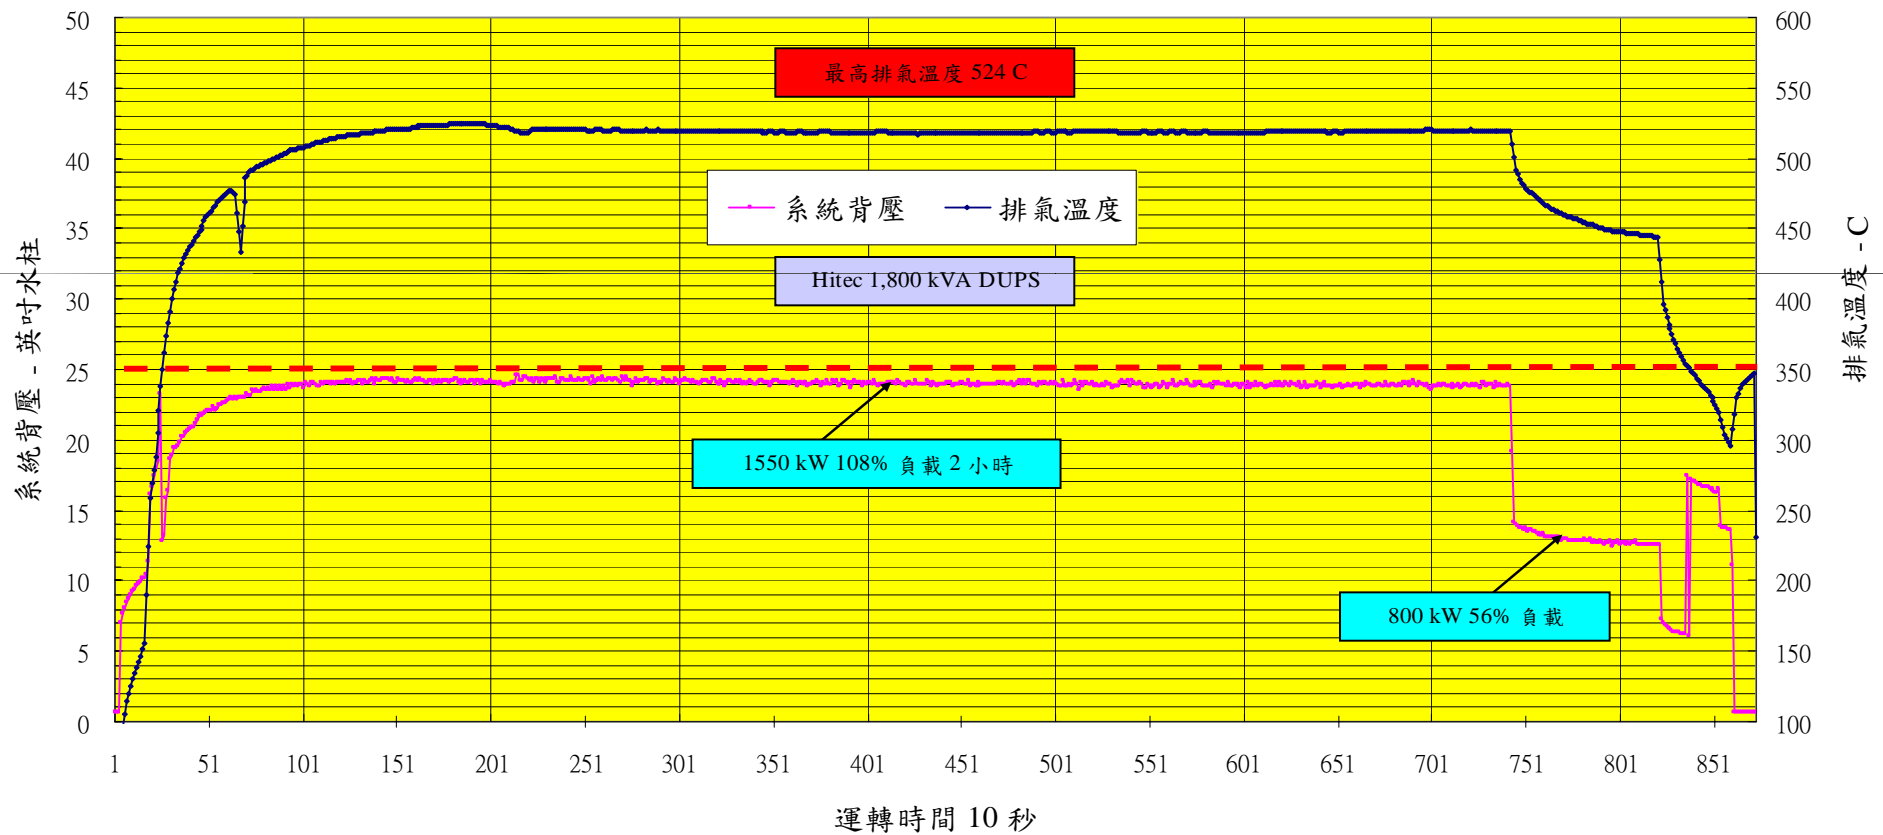

1800 kVA Hitec D-UPS
Year 2006 ProMOS Tech.